


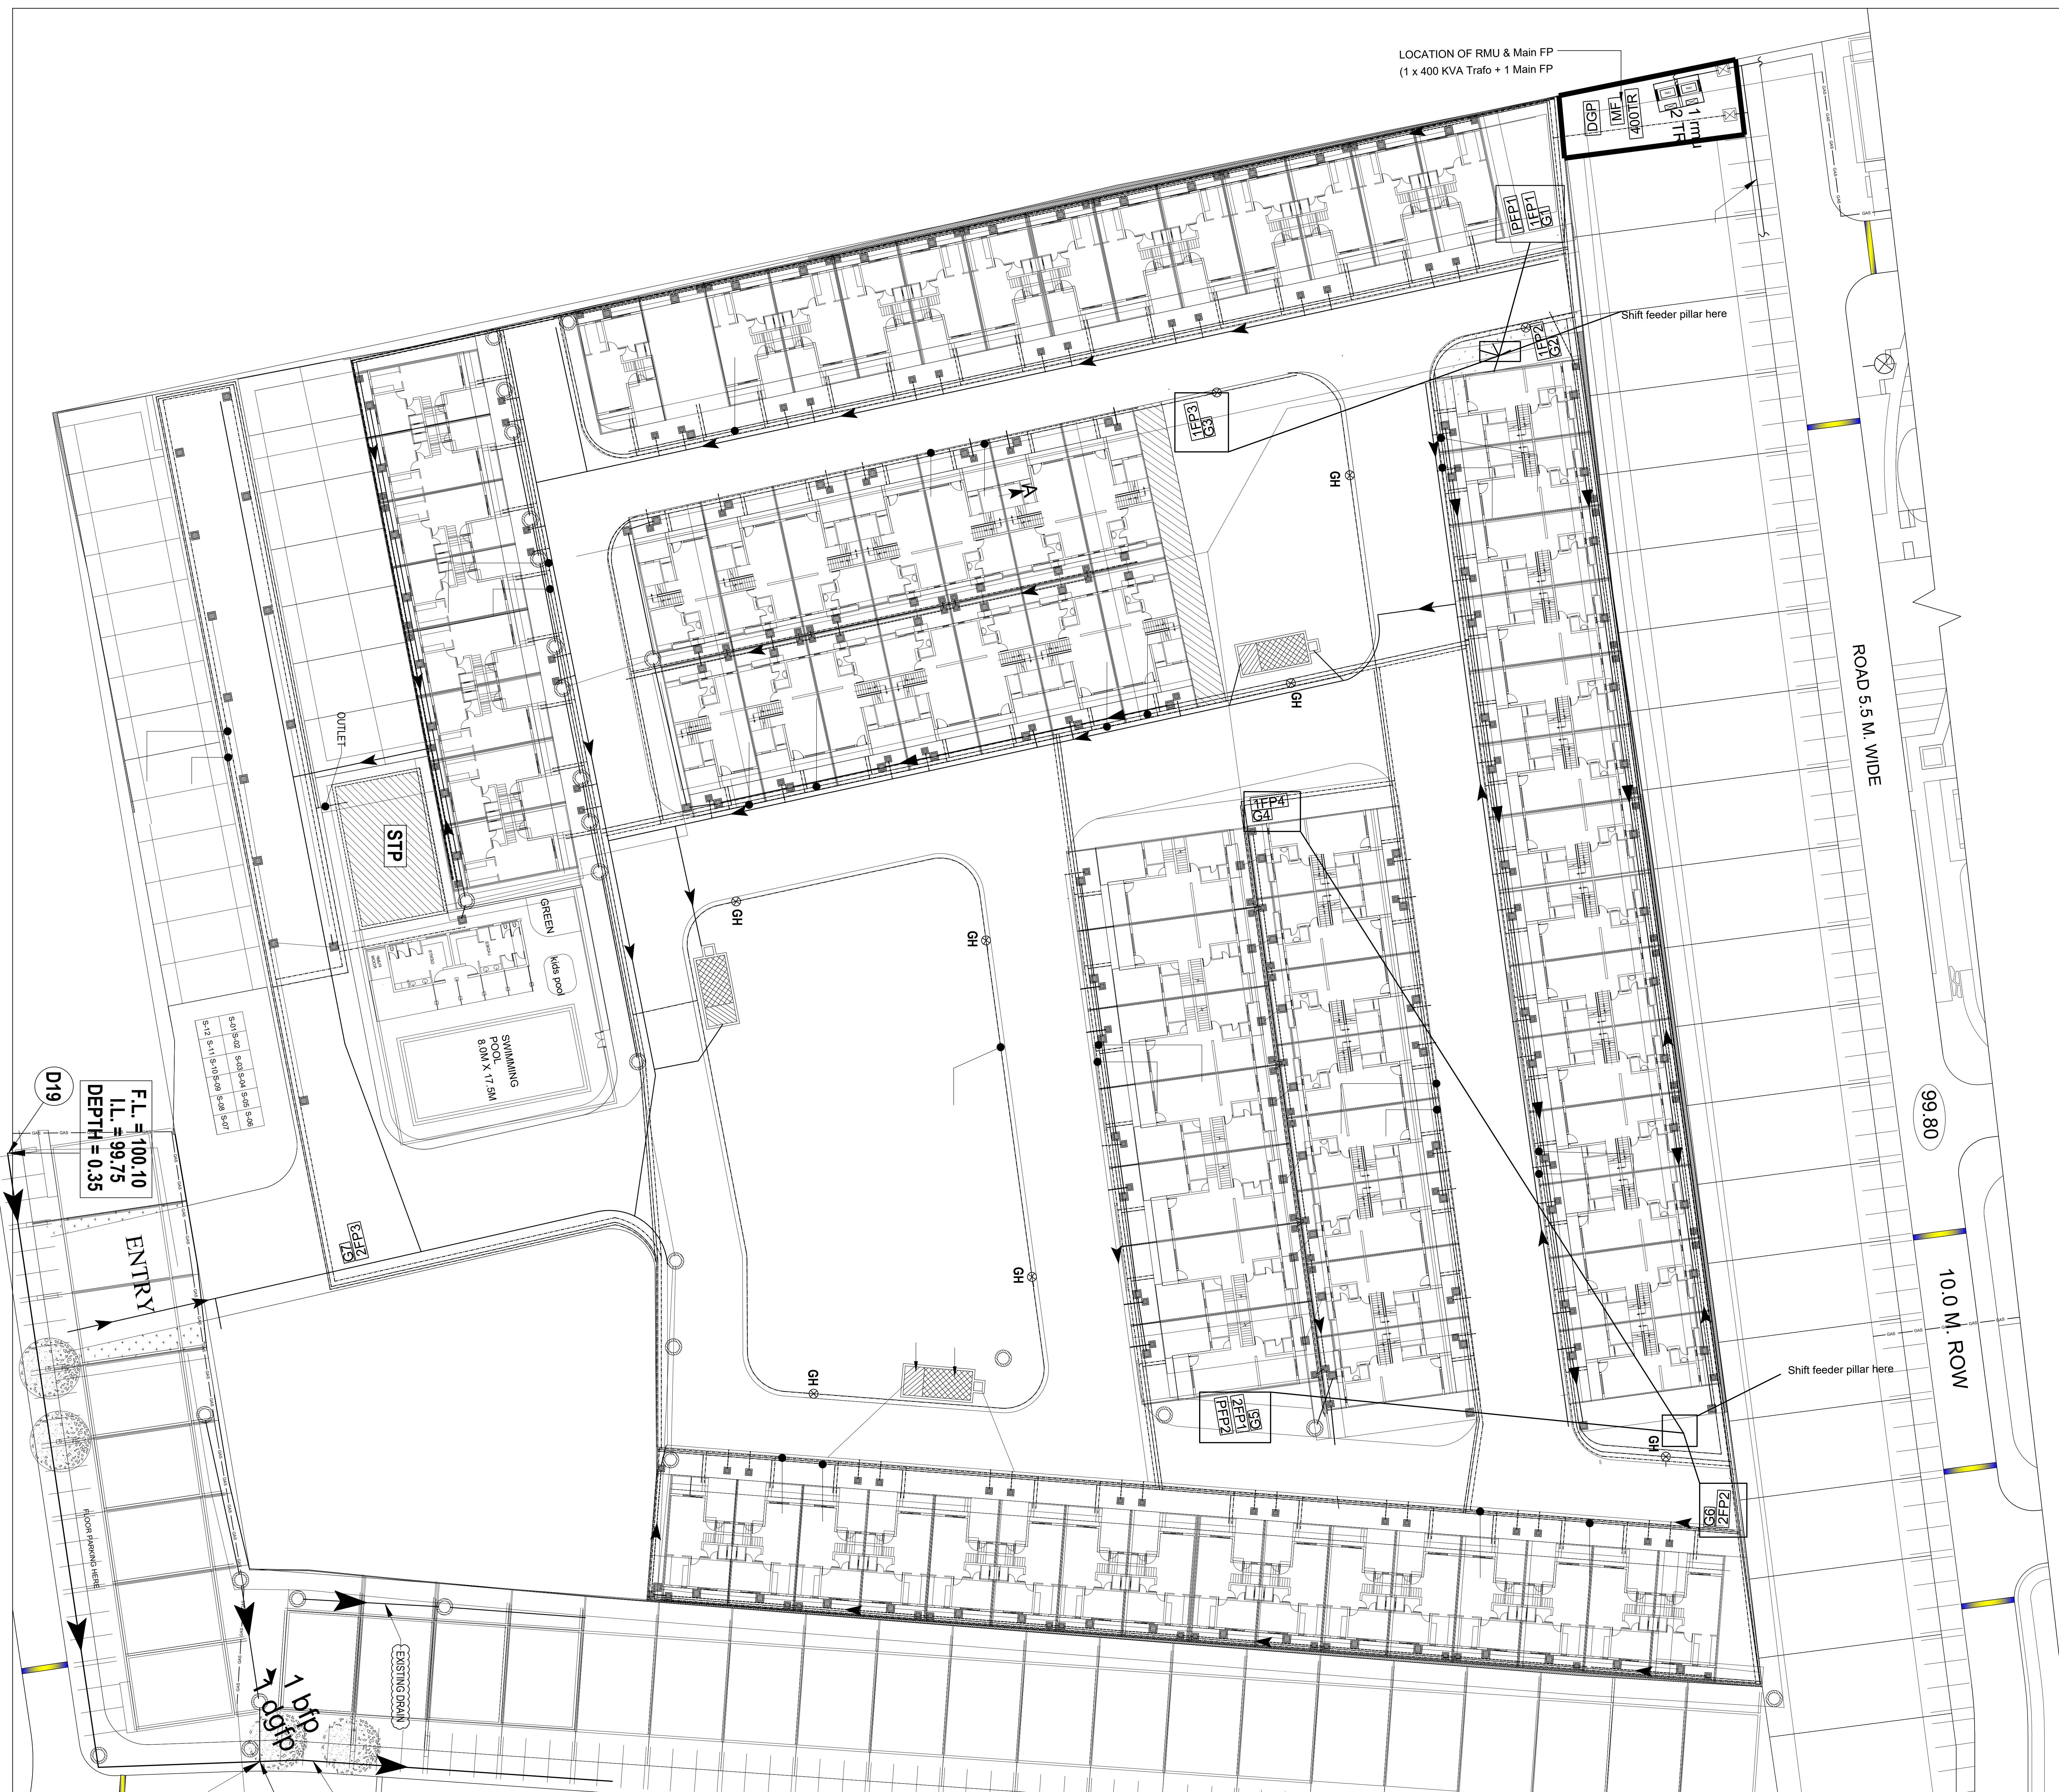


- ELECTRICAL LEGENDS
- MF MAIN DISTN. FEEDER
NEAR 400KVA TRAFO AT PH.II
 - DGP SUB-MAIN DG PILLAR FOR EXT.
 - PFP PRIMARY FEEDER PILLARS
FOR MAINS POWER: 2 NOS
 - FP SECONDARY FEEDER PILLARS
FOR MAINS POWER : 4 + 3 NOS
 - G1, G2 etc. DGDB ATTACHED ON FP

NOTE:

SITE TO DECIDE THE ROUTES OF CABLES
AND ALSO MAY DISCUSS WITH CONSULTANT IN
CASE OF ANY DOUBTS/ PROBLEMS.

REFER SEPARATE DRAWING/ SKETCH FOR
CABLE SIZES etc.

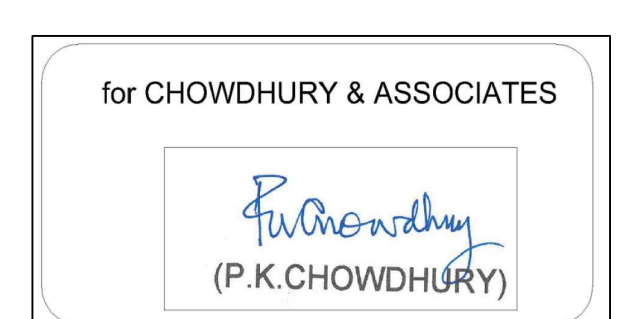

GG EXTENSION
LOCATION OF PRIMARY, SECONDARY
FEEDER PILLARS WITH DG DISTRIBUTION
BOARD.