




GROUND FLOOR EXTERNAL FIRE HYDRANT RING LINE LAYOUT PLAN

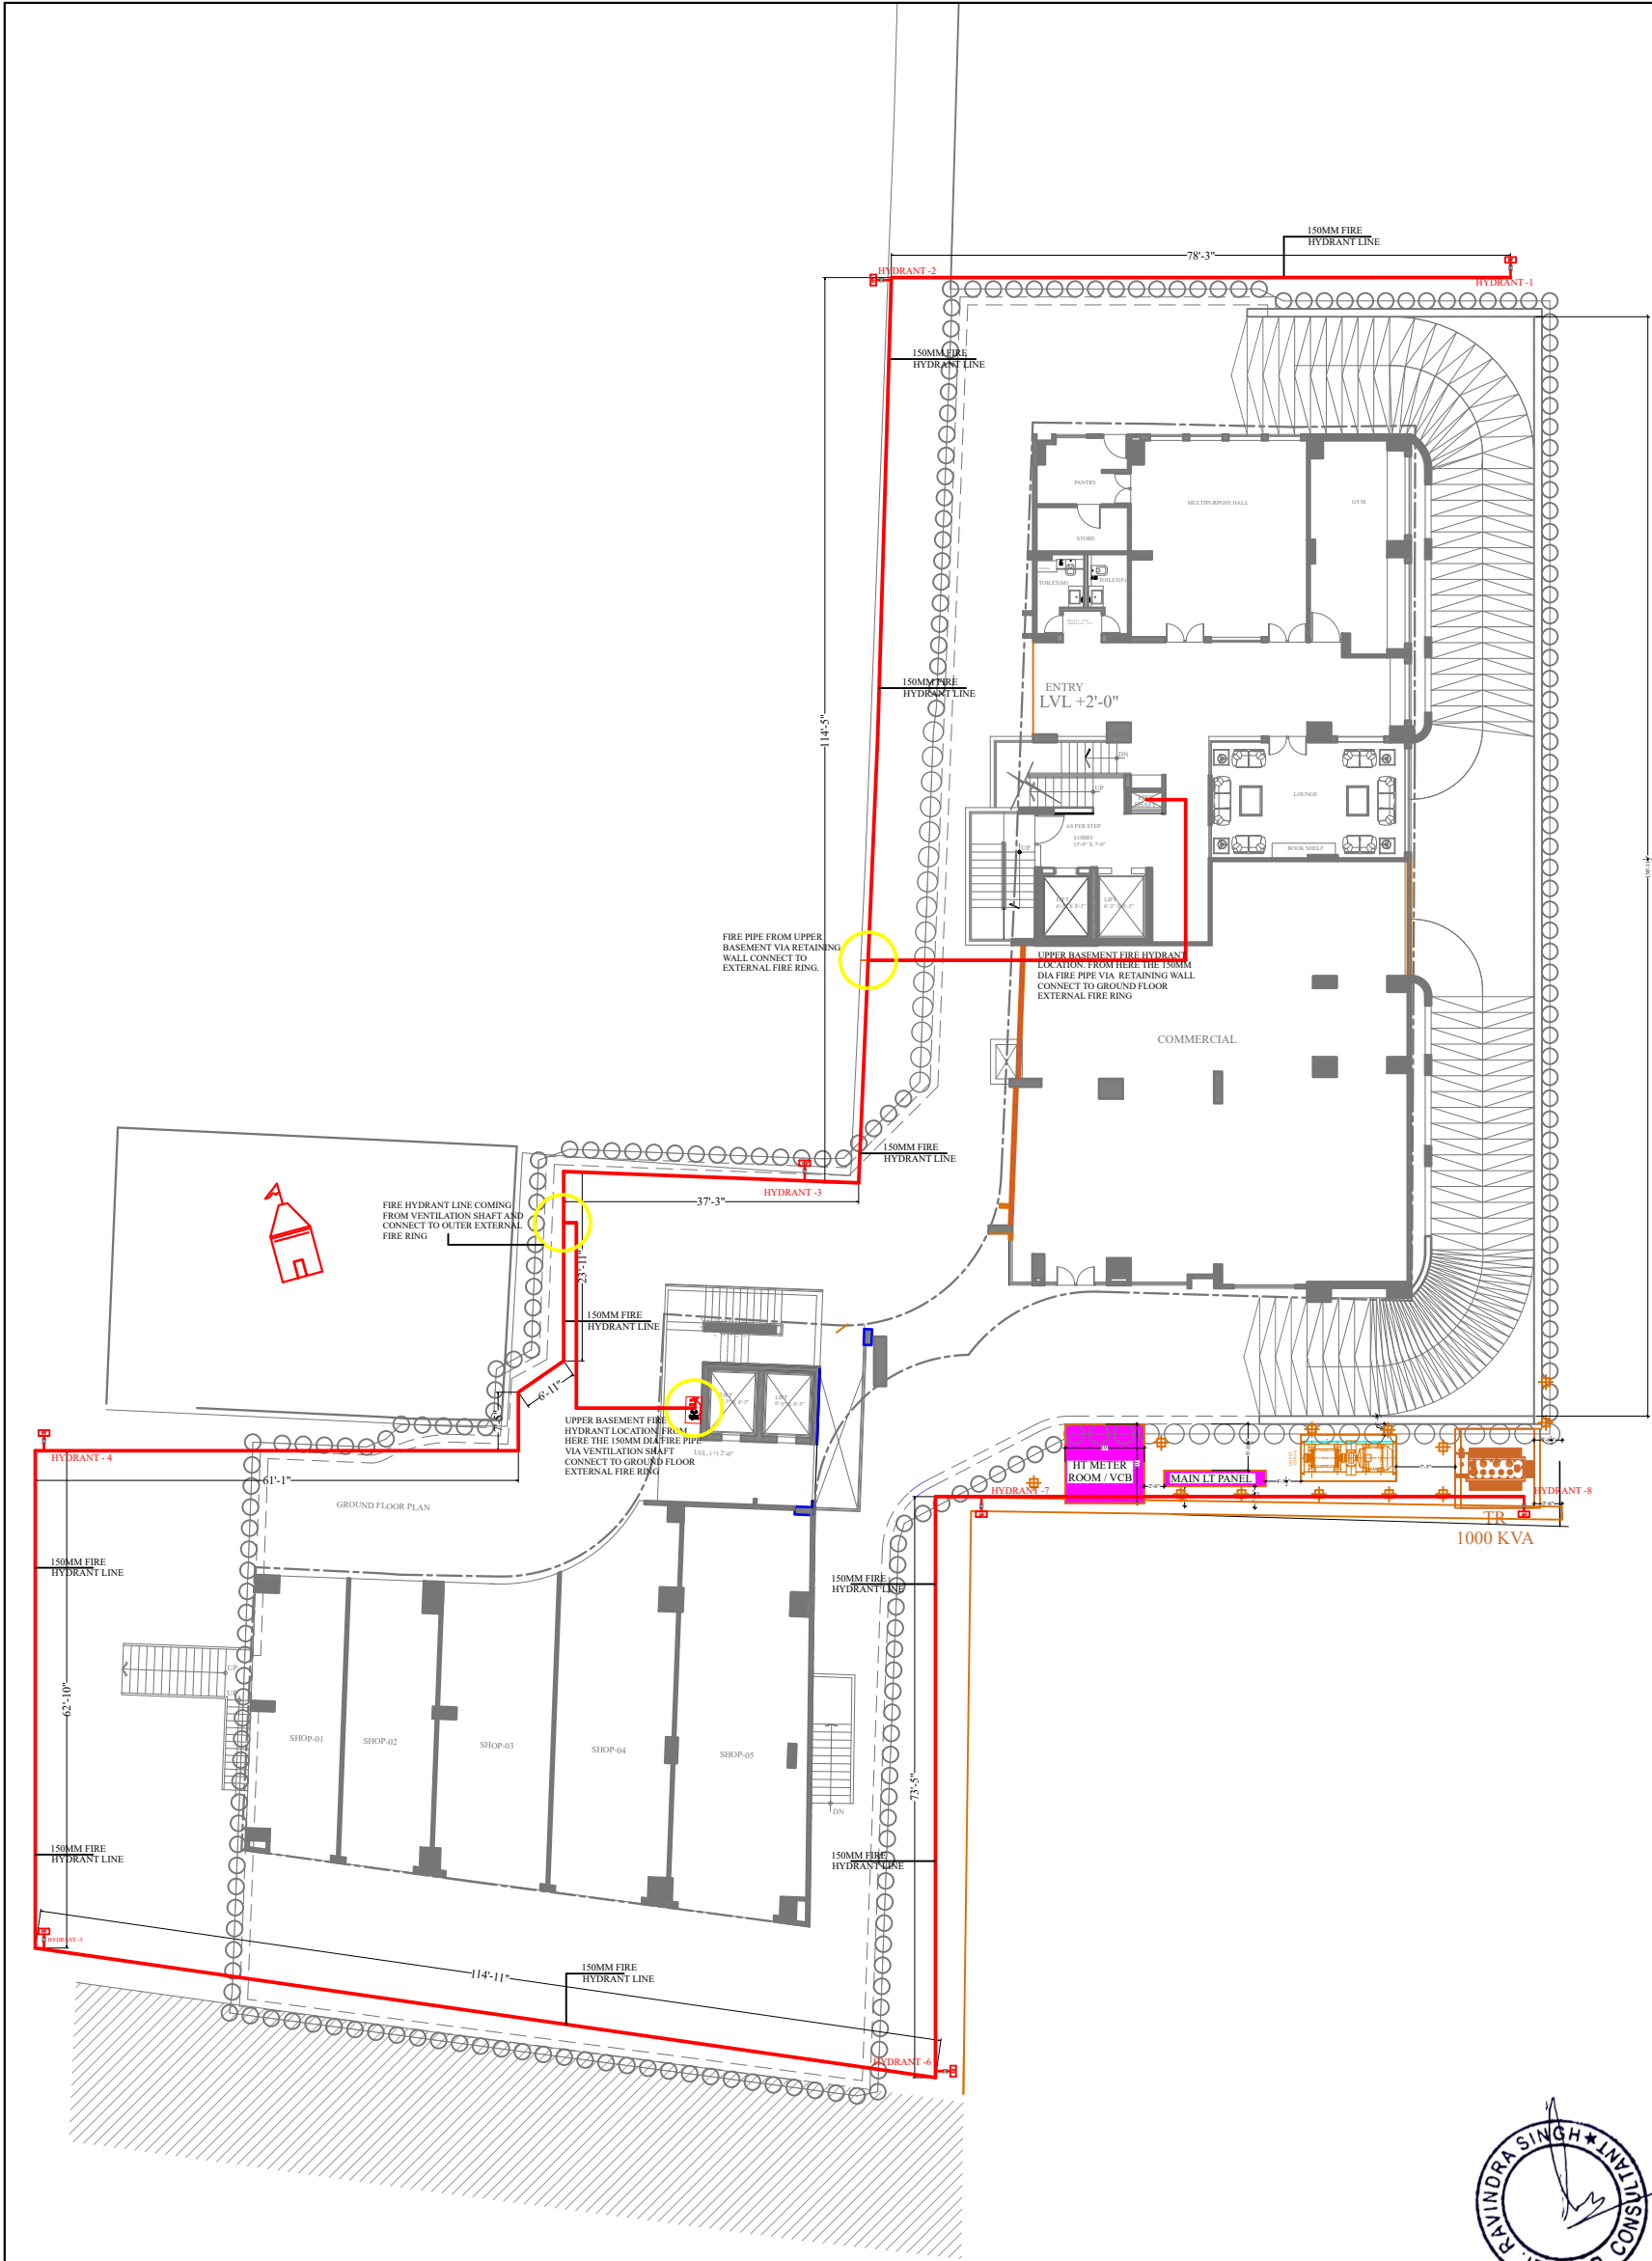

LEGENDS:

Mounting Ht.	Qty.	Symbol	Description
BELOW RCC SLAB		—	25MM DIA MS 'B' CLASS' PIPE
BELOW RCC SLAB		—	32MM DIA MS 'B' CLASS' PIPE
BELOW RCC SLAB		—	40MM DIA MS 'B' CLASS' PIPE
BELOW RCC SLAB		—	50MM DIA MS 'B' CLASS' PIPE
BELOW RCC SLAB		—	65MM DIA MS 'B' CLASS' PIPE
BELOW RCC SLAB		—	80MM DIA MS 'B' CLASS' PIPE
BELOW RCC SLAB		—	100MM DIA MS 'B' CLASS' PIPE
BELOW RCC SLAB		—	150MM DIA MS 'B' CLASS' PIPE
BELOW RCC SLAB			PENDENT SPRINKLER
BELOW SLAB			REDUCER SOCKET

SPRINKLER PIPE DIA CHART AS PER NFPA - 13-TABLE- 2.3.5.2.4

NO OF SPRINKLER	SPRINKLER PIPE DIA
1-2	25Ø
3	32Ø
4-5	40Ø
6-10	50Ø
11-20	65Ø
21-40	80Ø
41-100	100Ø
101 TO ABOVE	150Ø

MEP CONSULTANT :



JR Square

Engineers & Consultancy Pvt. Ltd.

LG-28,29 Jaipur Electronic Market, Ridhi Sidhi Circle, Gopal pura by Pass Road , Jaipur (Raj)
Ph:- 8696311408, 9971998408
Email:- ravisongira72@gmail.com ; ravi@jrsquareengineers.com

PROJECT:- PLOT NO.16. GOVIND MARG ADARSH NAGAR,RAJA PARK JAIPUR

DRAWING TITLE:-
GROUND FLOOR EXTERNAL FIRE HYDRANT RING LINE LAYOUT

CHECKED BY:- RAVI
DEALT:- SAGAR
DRAWN:- MANISH
DATE:- 25.12.2023

PROJECT CONSULTANTS

IDEAS

124, HIMMAT NGR.TONK ROAD JPR.
Ph- 2706227,2712377
email: studio@ideasjaipur.com, web: www.ideasjaipur.com