


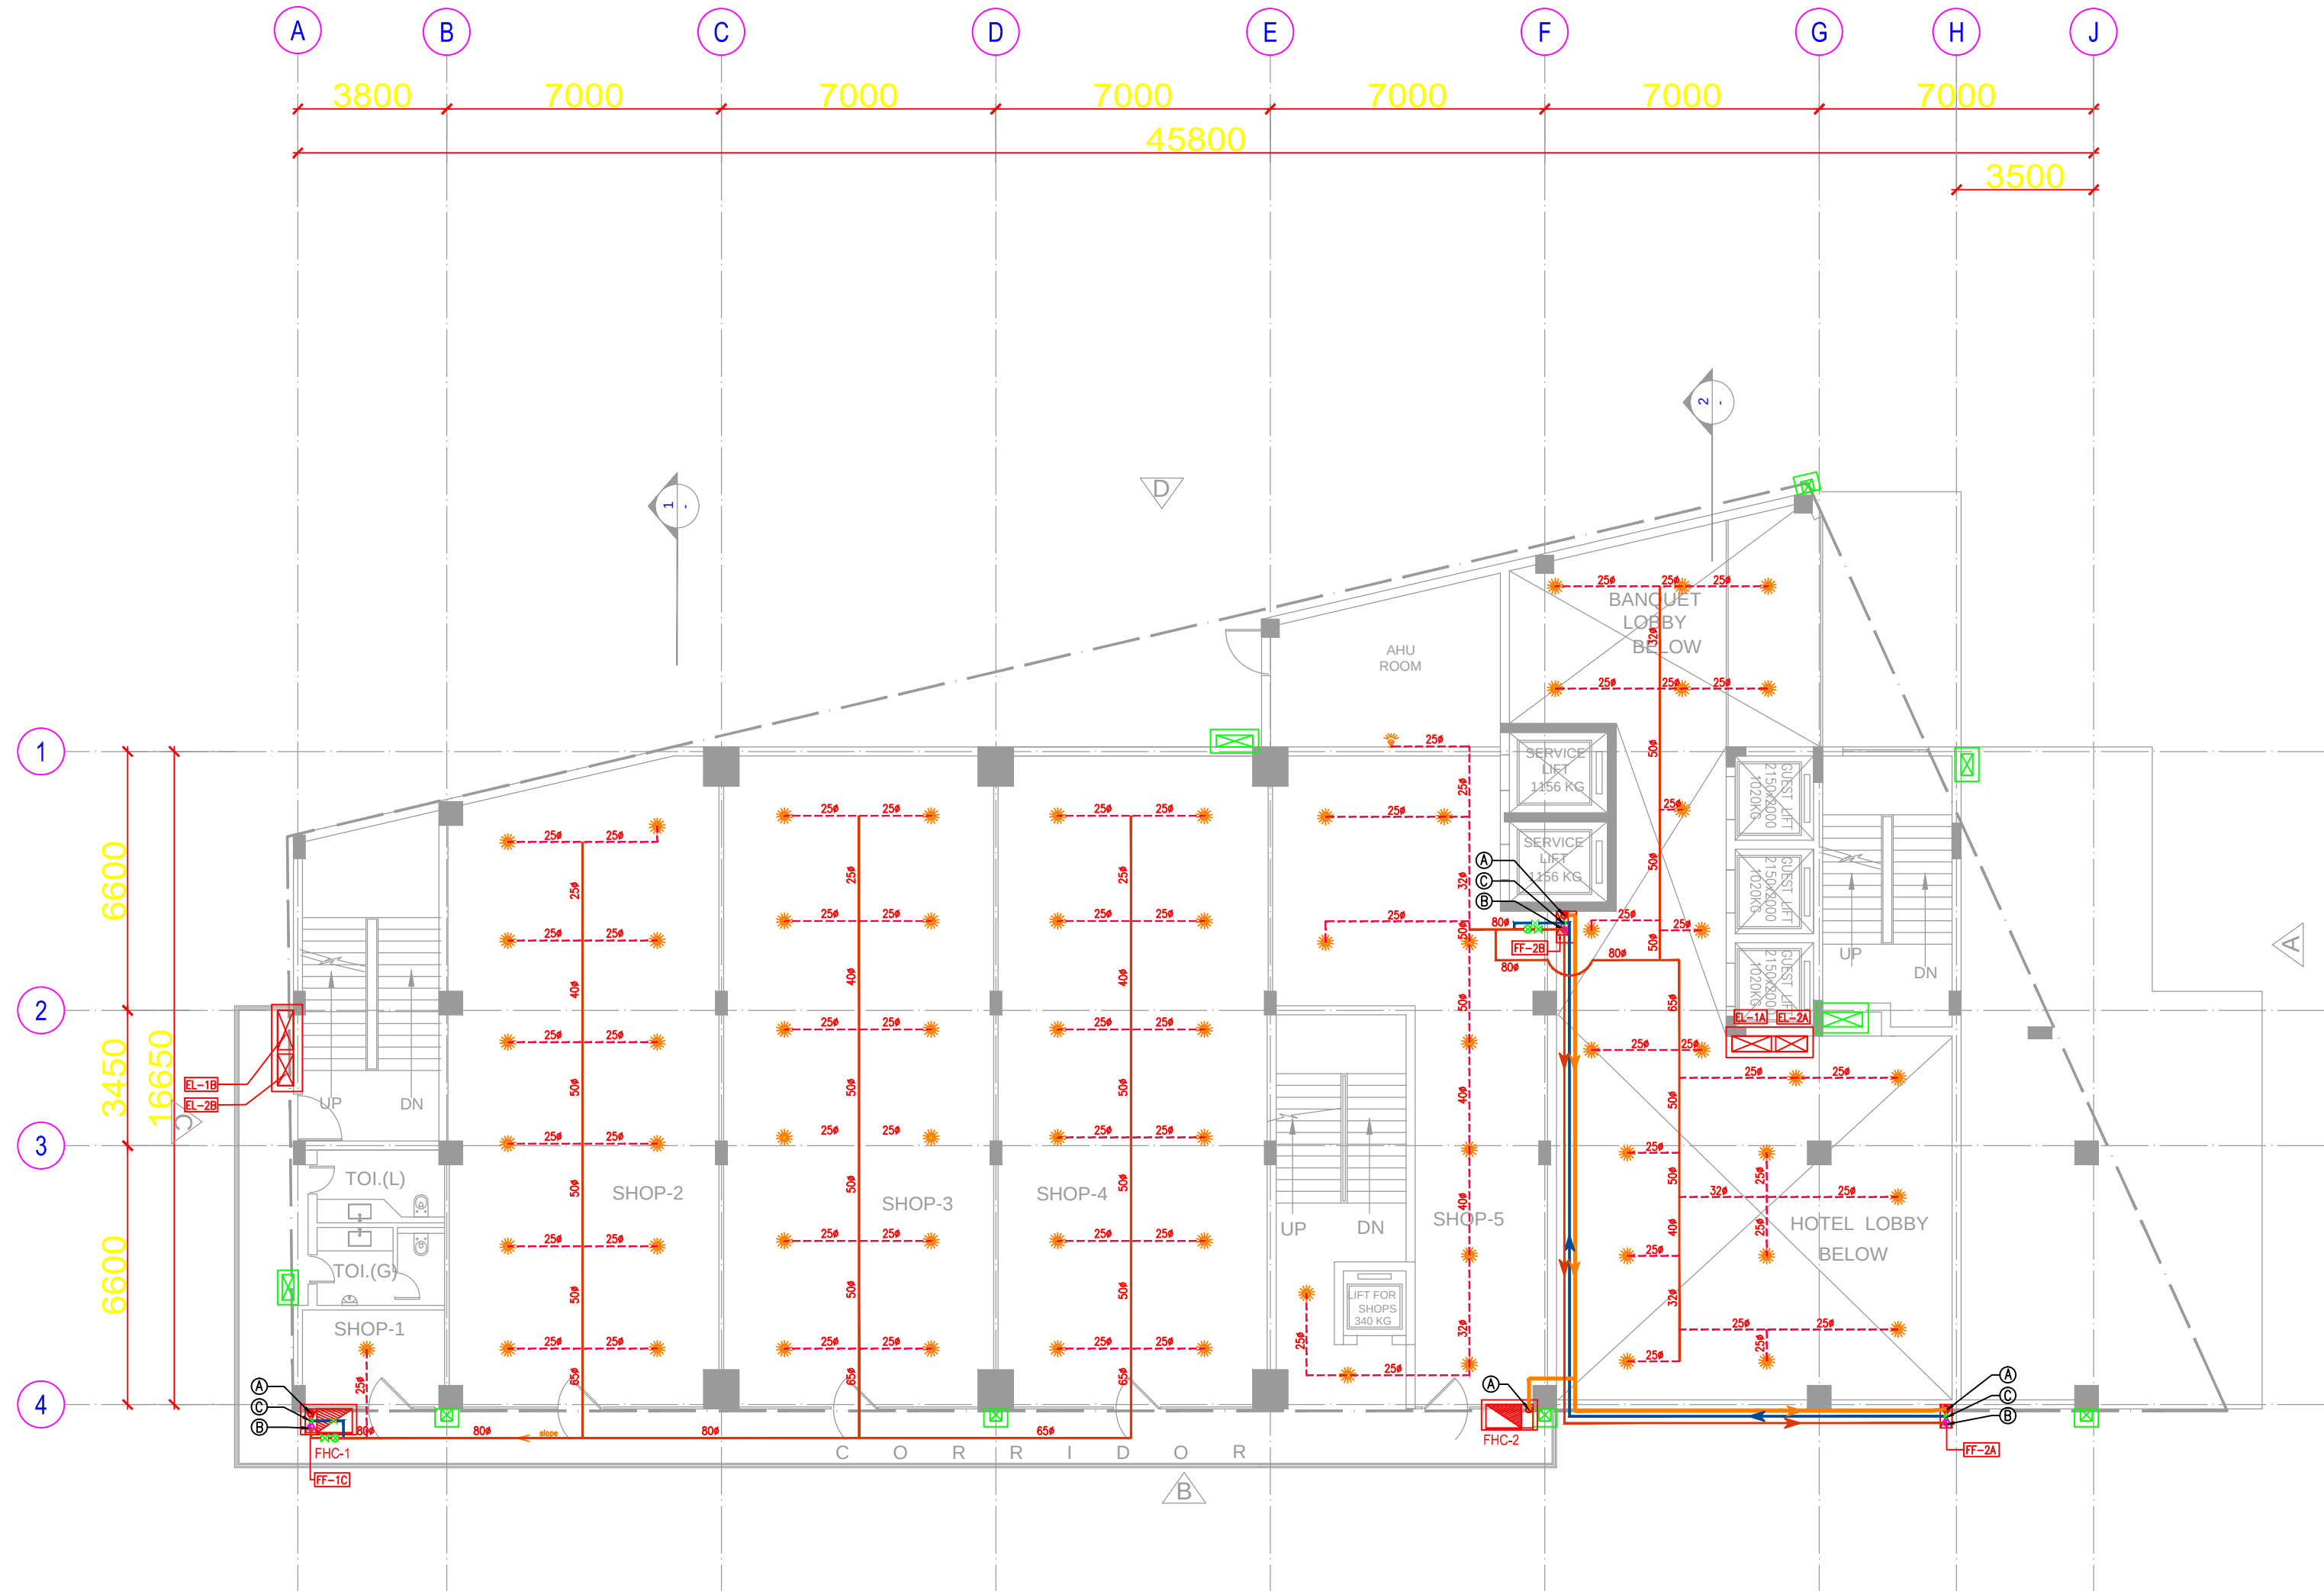

LEGEND FOR FIRE FIGHTING:-

SYMBOL	DESCRIPTION
	PENDENT SPRINKLER (QUICK RESPONSE TYPE)
	SIDE WALL SPRINKLER (QUICK RESPONSE TYPE)
	UPRIGHT SPRINKLER (QUICK RESPONSE TYPE)
	DRY SPRINKLER (PENDANT TYPE)
FHC	FIRE HOSE CABINET
	BALL / BUTTERFLY VALVE
	FLOW SWITCH

HORIZONTAL SPRINKLER PIPE DIA. SHALL BE AS FOLLOWS.	
NO.OF SPRINKLER	DIA.
1 TO 2	25Ø
3	32Ø
4 TO 5	40Ø
6 TO 10	50Ø
11 TO 18	65Ø
19 TO 40	80Ø
41 TO 100	100Ø
ABOVE 100	150Ø

TAG	DESCRIPTION
(A)	150Ø PIPE FOR INTERNAL HYDRANT
(B)	150Ø PIPE FOR FIRE SPRINKLER
(C)	80Ø PIPE FOR FIRE SPRINKLER DRAIN
(D)	150Ø PIPE FOR EXTERNAL HYDRANT

NO. OF PRINTS	ISSUED TO	DATE
S.N.	DATE	DETAILS
REVISIONS		

PROJECT TITLE:-
PROPOSED SAROVAR HOTEL
AT ALWAR, RAJASTHAN

CLIENT/DEVELOPER:-
.....

ARCHITECTS:-
ASA A SHARMA ASSOCIATES
E-302, EAST OF KAILASH, NEW DELHI-65
PH:28401700,28475054,28451886, FAX:28478413
e-mail: msa@asharma.com, www.asharma.com

MEP CONSULTANTS:-
C TO C Consulting Engineers Pvt. Ltd.
E-28, - (Basement) East of Kailash,
New Delhi-110065 (INDIA)
Tel.: 011-43042523, 43052523

STAGE:-
SUBMISSION

DRAWING TITLE:-
**FIRST FLOOR
FIRE FIGHTING LAYOUT**

Designed		Approved	
Avtar		V.K.	
Scale	Date	Rev. No.	
1:100@A1	11.11.2021	R-0	
Drawing No.	CTOC.FF-04		NORTH 

ARCHITECT SIG.

OWNER SIG.

MEP CONSULTANTS SIG.