


# ASHAPURNA MOHANBAGH VII KHARA NO. 50/9 ,50/11 ,50/14 , EXTERNAL ELECTRIFICATION DRAWING

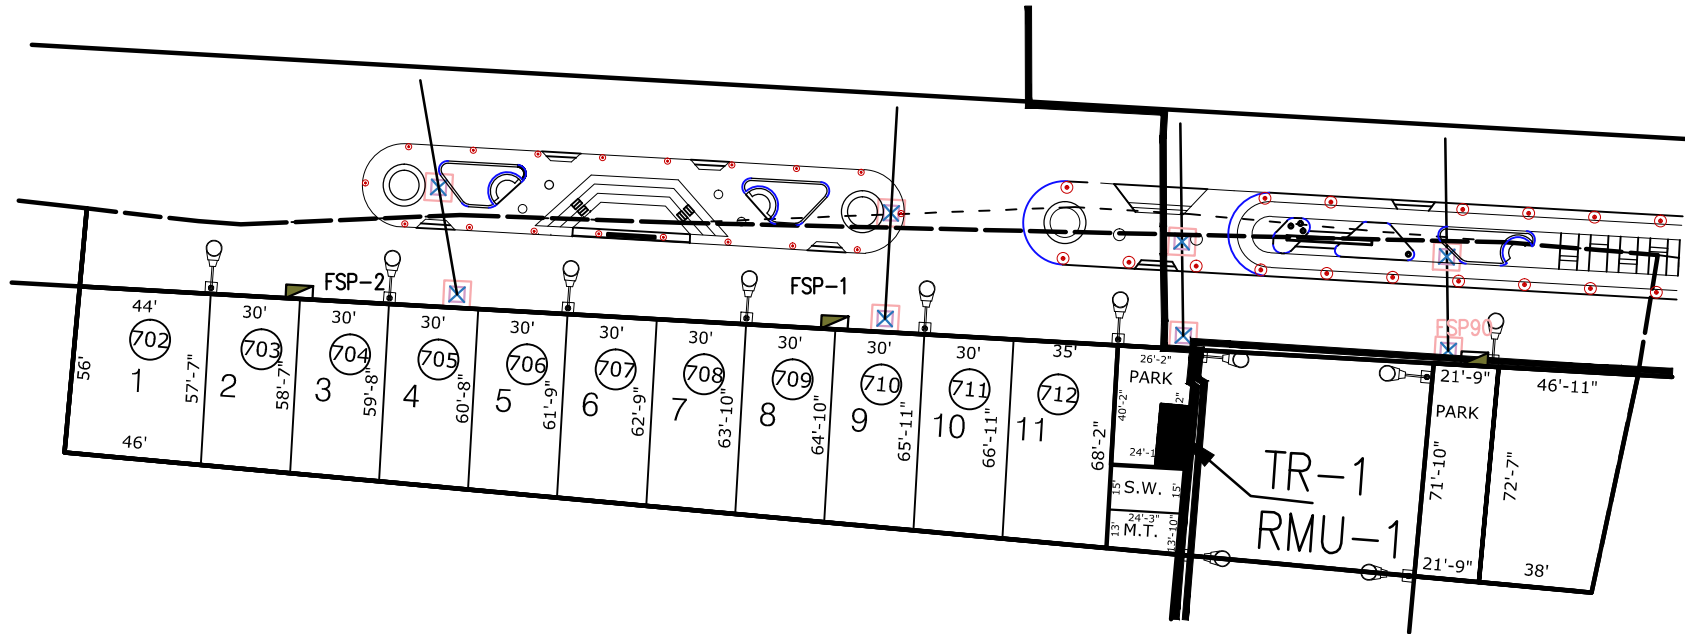

NOTE : THAT THIS PLAN IS ONLY TENTATIVE  
SOME CHANGES MIGHT HAPPEN AS PER SITE  
CONDITION

| ELECTRICAL PLAN |   |
|-----------------|---|
| —               | 2"Ø LV PVC CABLE PIPE AND                         |
| —               | 12"Ø ELECTRICAL LT SERVICE CABLE @                |
| —               | PVC OR RCC HUME PIPE PIPE                         |
| —               | 12"Ø ELECTRICAL LT SERVICE CABLE @                |
| —               | PVC OR RCC HUME PIPE PIPE                         |
| ■               | FEEDER SECTION PILLAR                             |
| ⊗               | ELECTRICAL LT SERVICE CABLE CHAMBER               |
|                 | SIZE: 24" X 24" X AS DEPTH                        |
| ⊗               | ELECTRICAL CHAMBER 11KV HT CABLE IN MAIN          |
|                 | 150FEET ROAD CROSSING. SIZE: 24" X 36" X AS DEPTH |

PLOT NO. 1 TO 12  
ASHAPURNA MOHANBAGH VII  
KHARA NO. 50/9 ,50/11 ,50/14 ,

*Gaurav*  
**GAURAV JOSHI**  
CIVIL ENGINEER  
12, Near Maheshwari Nayati Nohra  
Masuriya, Jodhpur