





LEGEND :		
S. No.	SYMBOL	DESCRIPTION
1.		DOMESTIC WATER SUPPLY LINE
2.		RISEING MAIN LINE (FROM T/W TO U.G.T.)
3.		MUNICIPAL WATER SUPPLY LINE
4.		RECYCLED WATER SUPPLY PIPE LINE FOR FLUSHING & HORTICULTURE
5.		MASONRY CHAMBER FOR ISOLATING VALVE
6.		GARDEN HYDRANT
7.		PROPOSED TUBE WELL
8.		AIR RELEASE VALVE
9.		
10.		
11.		

NOTES : WATER SUPPLY	
1. The depth of domestic water supply main shall be	-1000 mm
2. The depth of recycle water supply main shall be	-900 mm
3. The depth of rising main shall be	-1000 mm
4. Pipe material for external water supply :-	
a) Domestic & recycle line shall be HDPE (PE100) PN10 OR PE80 / PN10	
b) Tube well rising main / municipal line shall be	HDPE (PE100) PN8 OR PE80 / PN8
5. Pipe material for all lower riser :- upvc (sch-80)	

ALL DOMESTIC TANK FILLING RISER = 400
ALL FLUSHING TANK FILLING RISER = 320

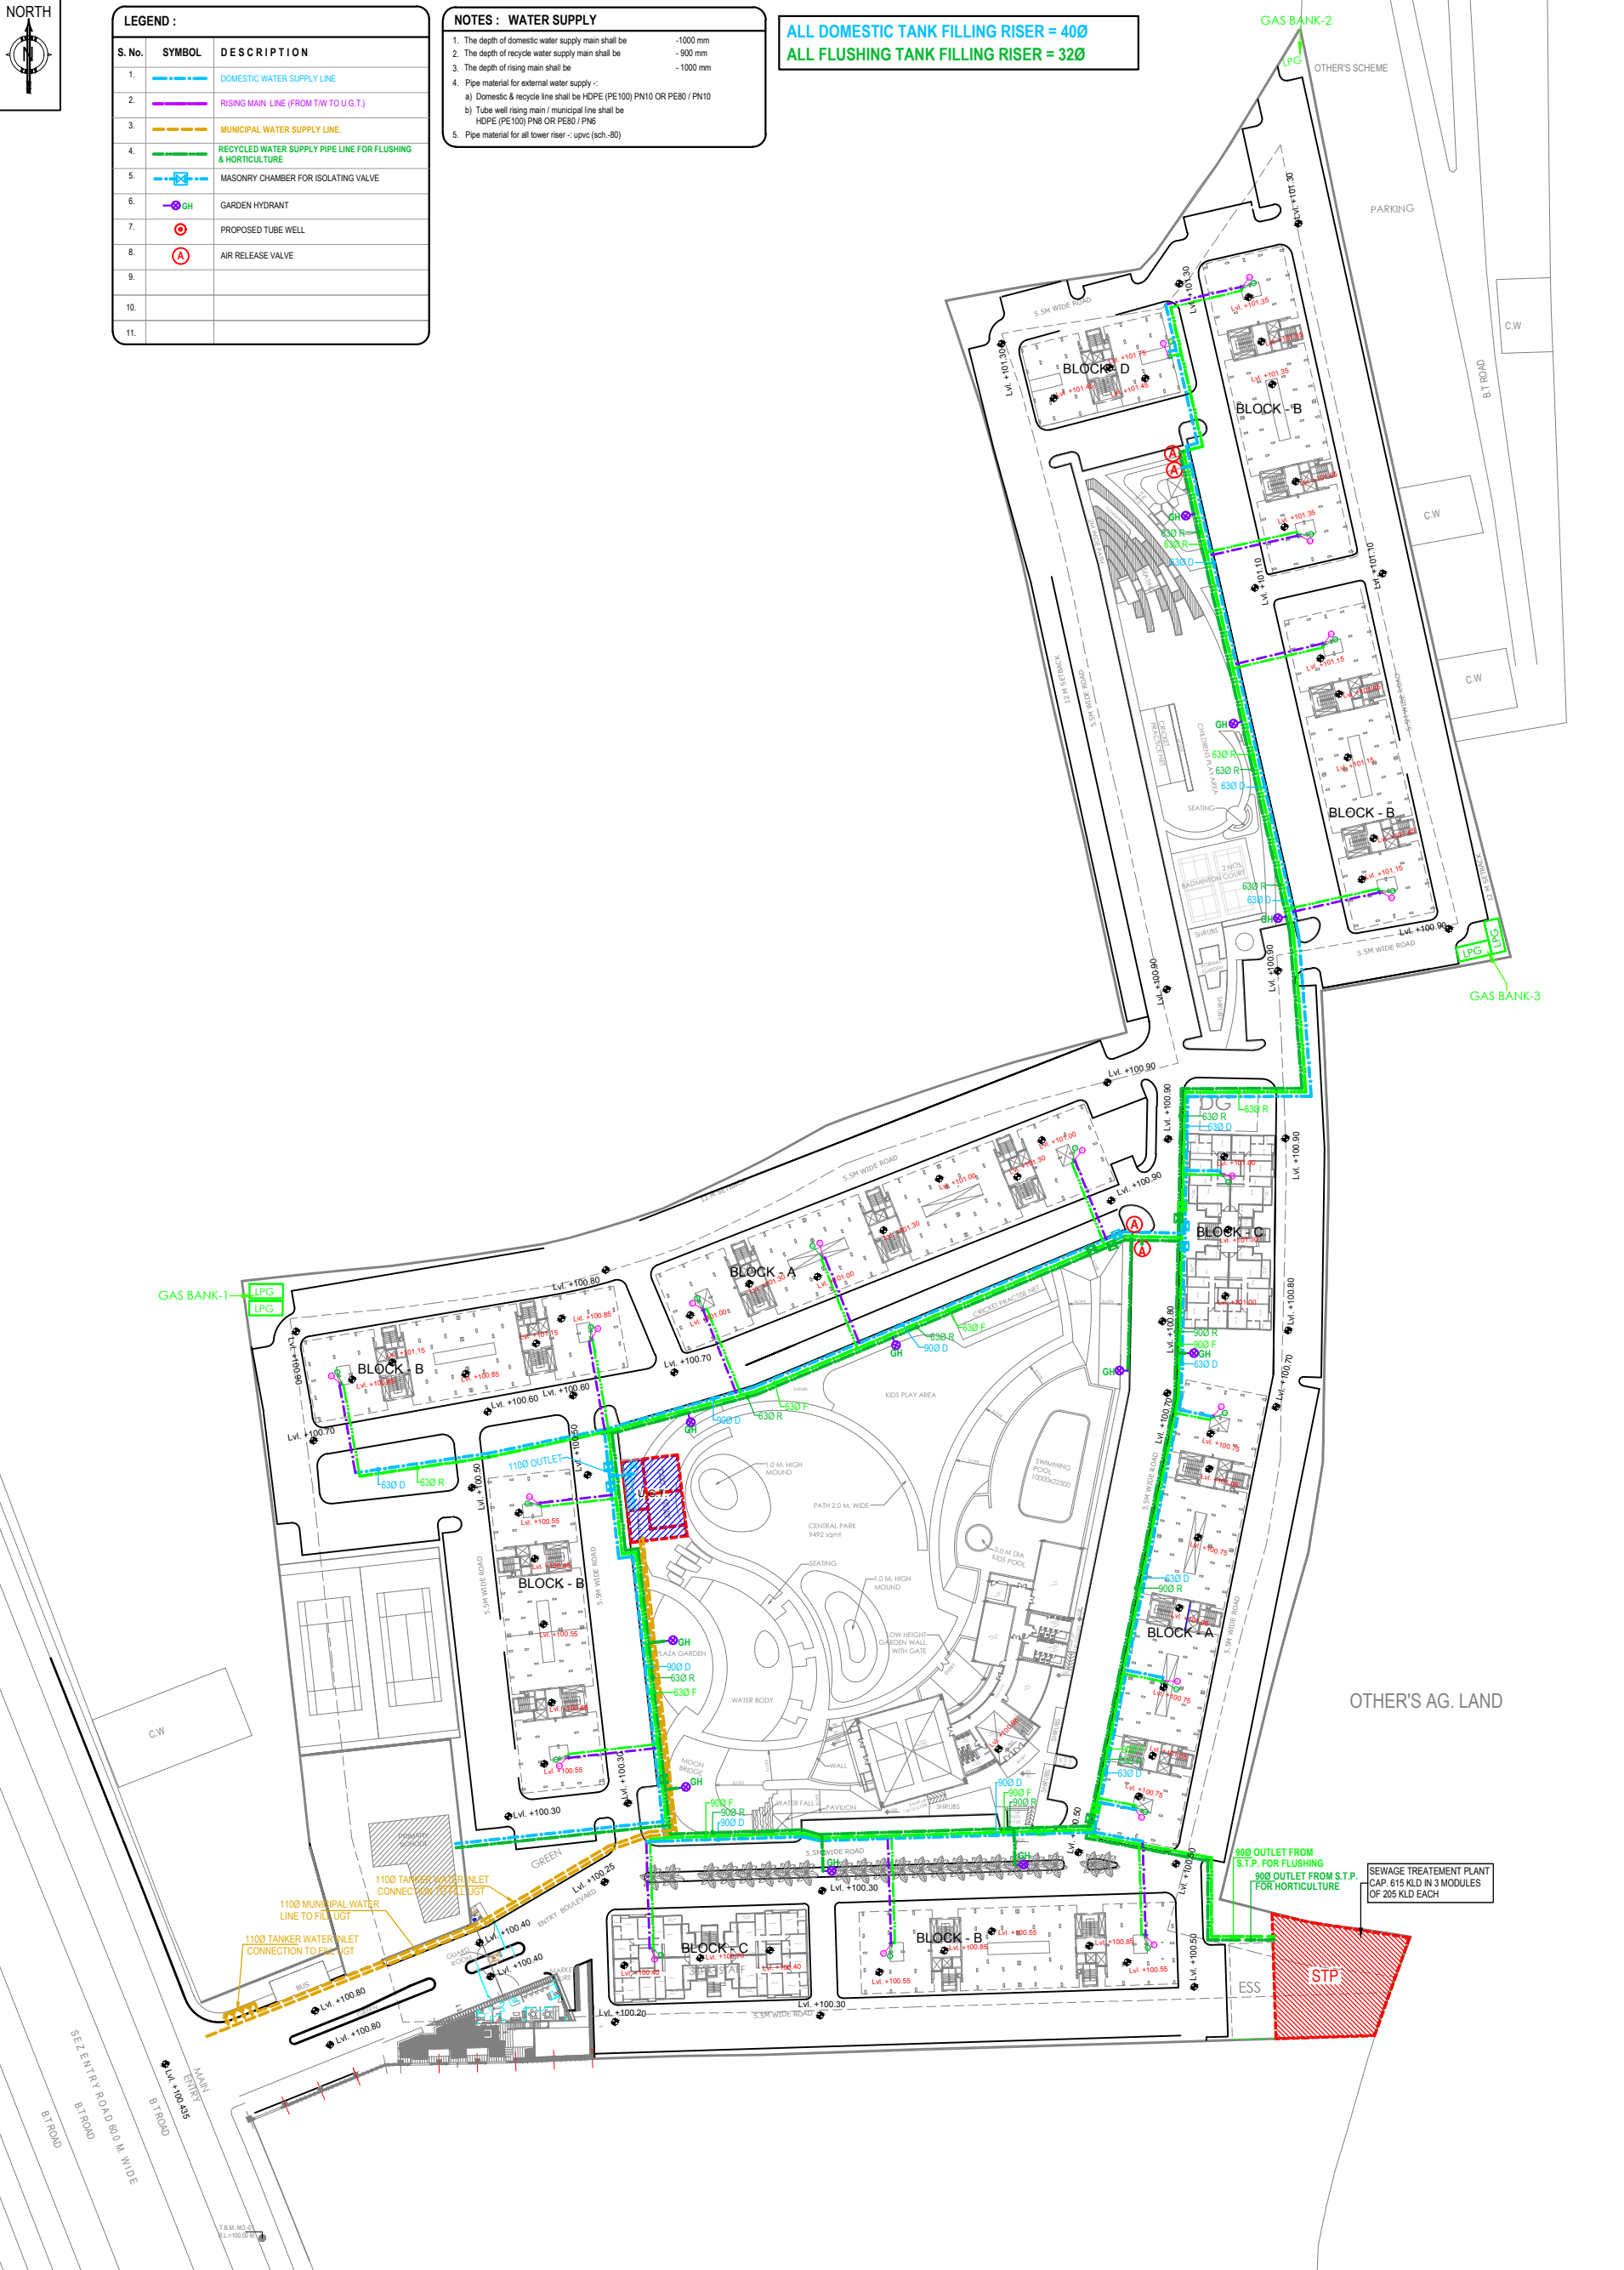

Project:- Ashiana Umang AT JAIPUR	Services Consultant : Consummate Engineering Services (P) Ltd.  Noida Office : B - 67, Sector - 67, Noida - 201 301 Tel : (0120) 2593509 / 30 Lines) Lko. Office : R 006, Rohtas Plumeria, Gomti Nagar, Lucknow Tel : (0522) 6515455 e mail : mail@cespl.in, website : www.cespl.in	Drg. Title: LAYOUT PLAN		Subtitle : EXTERNAL WATER SUPPLY SYSTEM				
		Scale: - 1 : 650		Drg. No : UMANG / ES-03		Drawn By : Amit Kamboj		
Owners Name  Ashiana Housing Ltd Unit no.4 & 5,Plot No.D-2,3rd Floor, Southern park, saket District Centre, Saket New Delhi - 110017 Phone no. 011- 42 65 42 45	Architect B.sengupta architect A305,RANGOLI,ASHIANAVILLAGEBHIWADI. PH. 09887488263	Date : - Sep. 2014		Design By : Nitesh Kumar				
		Issued For: APPROVAL		Ckd By : Anand Havelia		RO	28-07-2015	ISSUED AS GFC
						Rev	Date	Description